


# URSULA HALL

# FIRST FLOOR

~~FIRE EXTINGUISHER LOCATION~~ FIRST FLOOR ●


FIRE ALARM PULL STATIONS FIRST FLOOR ▲

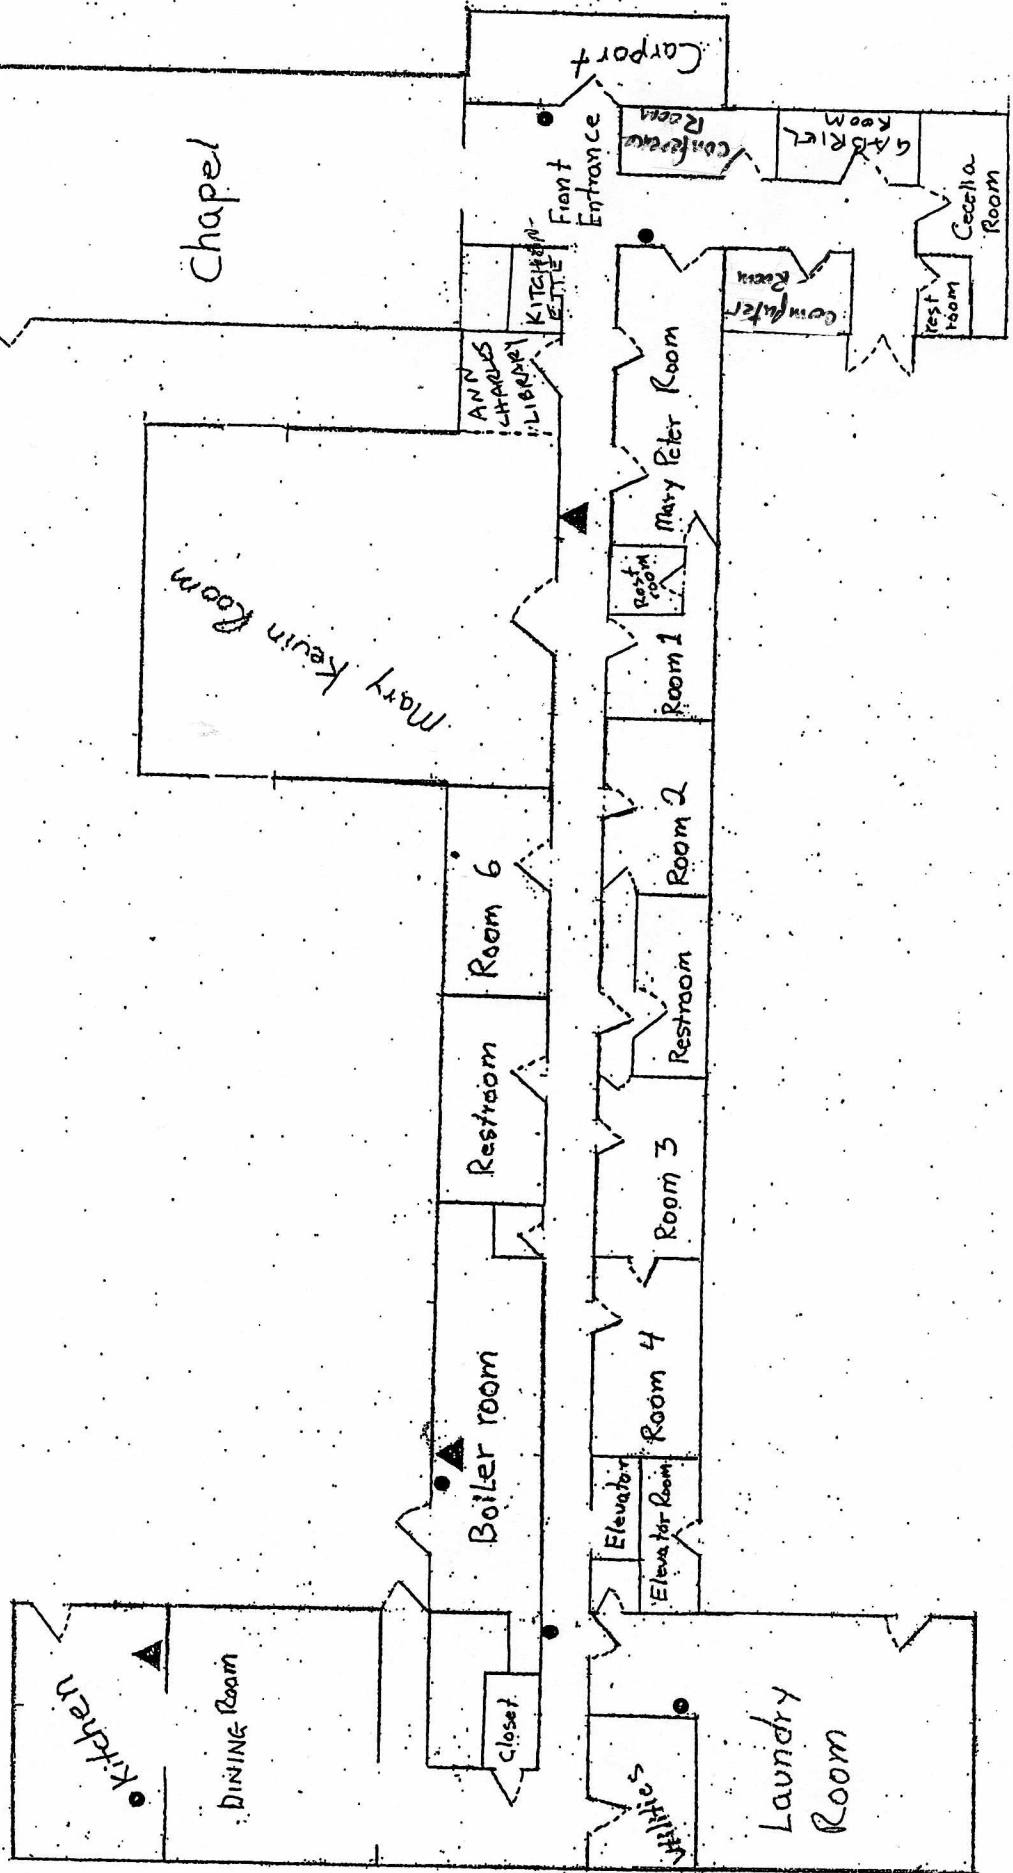

# URSULA HALL SECOND FLOOR

FIRE EXTINGUISHER LOCATION SECOND FLOOR

FIRE ALARM PULL STATIONS SECOND FLOOR

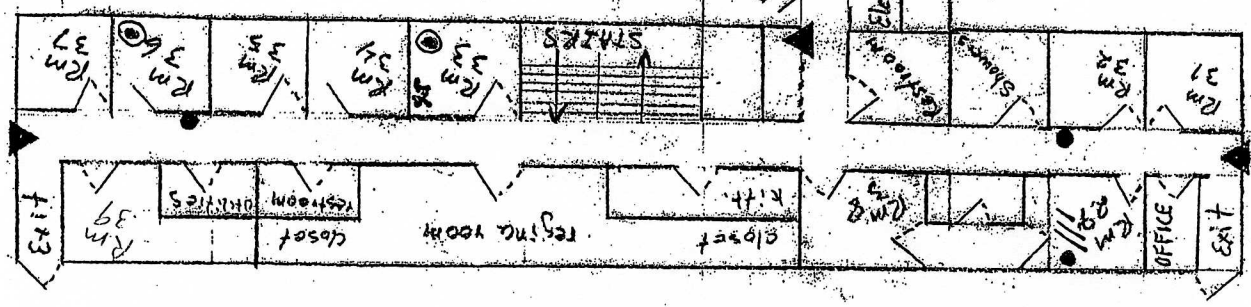

- No individual heating unit
- XT thermostat which controls heat in Rms 33 - 37.
- Avoid use if possible

